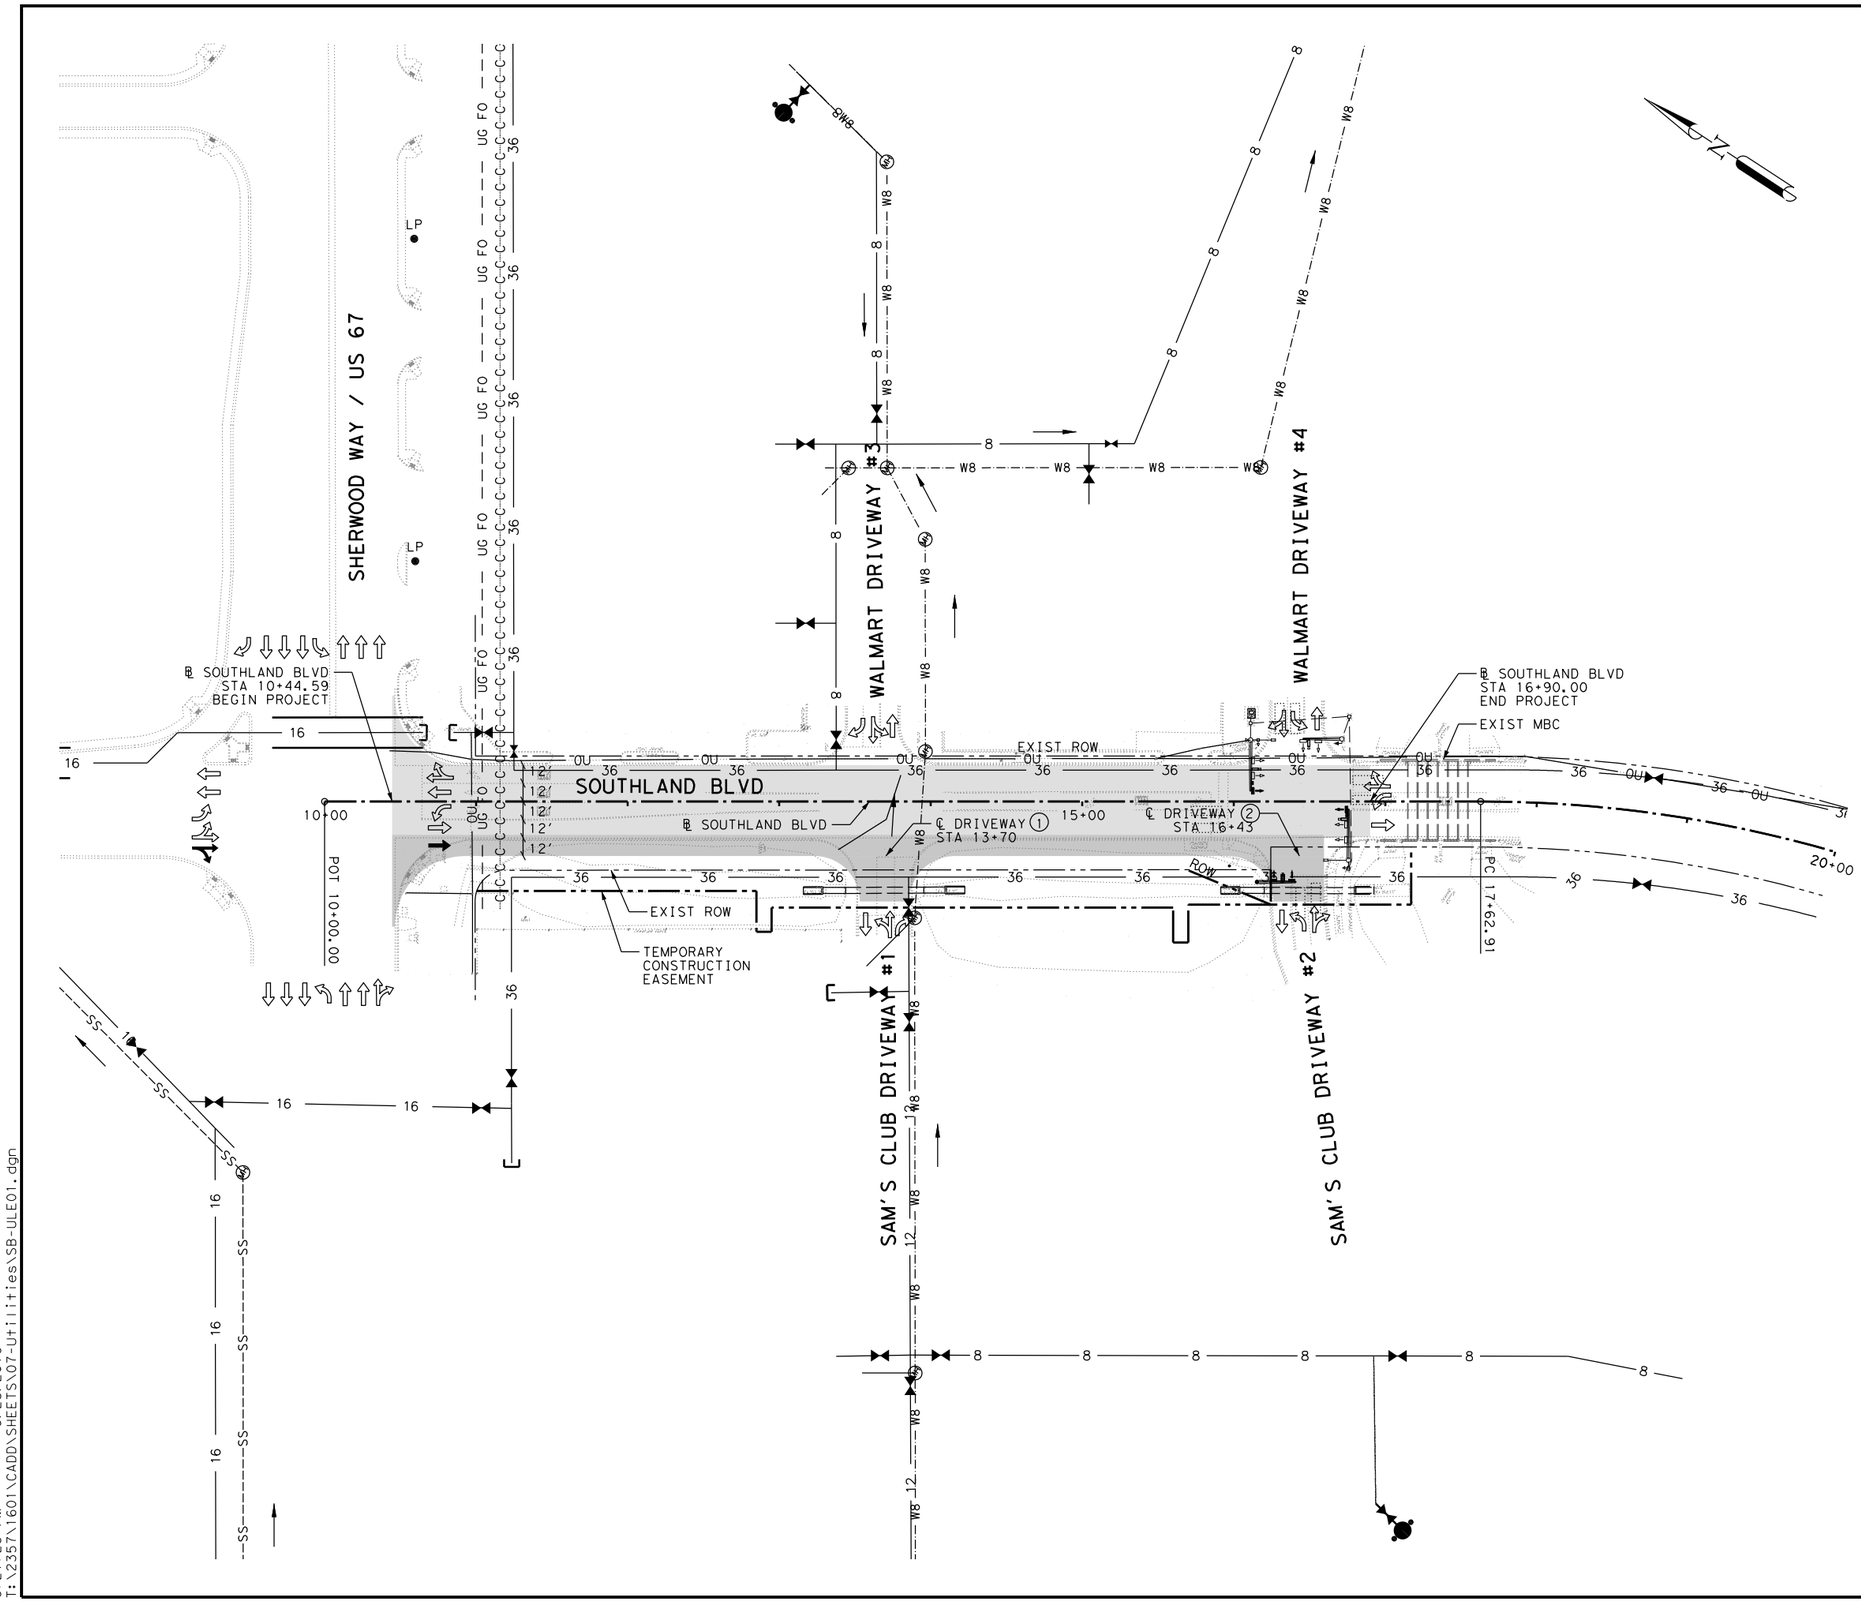

LEGEND

6	BURIED 6" WATER LINE PVC
8	BURIED 8" WATER LINE PVC
12	BURIED 12" WATER LINE PVC
16	BURIED 16" WATER LINE AC
36	BURIED 36" WATER LINE
	WATER VALVE
SS	BURIED SANITARY SEWER LINE
W8	BURIED 8" SEWER LINE
C	BURIED COPPER CABLE
UG FO	BURIED FIBER OPTIC CABLE
OU	EXISTING ELECTRIC LINE OVERHEAD
	GRAVITY FLOW DIRECTION
MH	MANHOLE
LP	LIGHT POLE

NOTES:

1. THE CONTRACTOR SHALL CONTACT TEXAS EXCAVATION SAFETY SYSTEM (800-DIG-TESS: 800-344-8377), CITY OF SAN ANGELO DISTRIBUTION OFFICE AT 325-657-4295, AND RELEVANT UTILITY COMPANIES 48 HOURS PRIOR TO LOCATING EXISTING UTILITIES AND/OR CONSTRUCTION ACTIVITIES.

09/23/2016

STATE OF TEXAS
MICHAEL C. COYLE
95634
LICENSED
PROFESSIONAL ENGINEER

0' 25' 50' 100'
SCALE: 1"=100'

REV. NO.	DATE	DESCRIPTION	BY

LJA Engineering, Inc.
FRN-F-1386

THE CITY OF SAN ANGELO TEXAS

SOUTHLAND BOULEVARD

EXISTING UTILITY LAYOUT

SHEET 1 OF 1

SHEET NO. 46

6:27:23 PM 9/23/2016
T:\2357\1601\CADD\SHEETS\07-Utilities\SB-ULE01.dgn